
Laser Distance Sensor
Triangulation

CP08MHT80
Part Number



- **CMOS line array**
- **Laser light**
- **Measured value independent of material, color and brightness**
- **Response time: < 660 µs (speed-mode)**
- **Zoom function**

These sensors work with a high-resolution CMOS line and DSP technology and determine distance using angular measurement. As a result, material, color and brightness related measurement differences are virtually eliminated.
Integrated analogue output can be configured for voltage 0...10 V (10...0 V) or current 4...20 mA (20...4 mA).

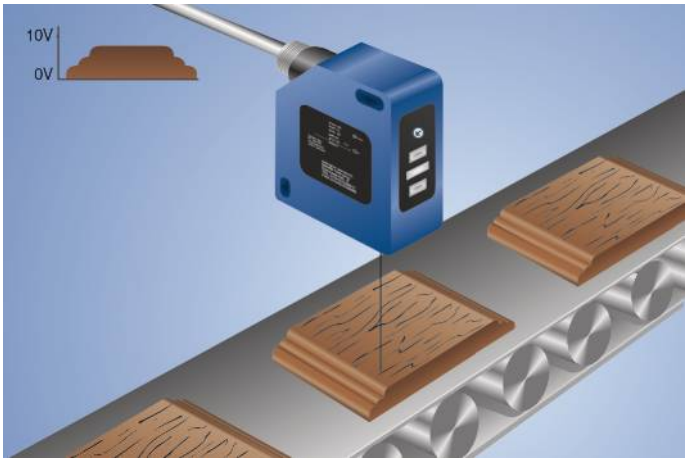


Technical Data

Optical Data	
Working Range	30...80 mm
Measuring Range	50 mm
Reproducibility maximum	60 µm
Reproducibility: 1 Sigma	20 µm
Linearity Deviation	80 µm
Light Source	Laser (red)
Wavelength	660 nm
Service Life (T = +25 °C)	100000 h
Laser Class (EN 60825-1)	2
Max. Ambient Light	10000 Lux
Light Spot Diameter	see Table 1
Electrical Data	
Supply Voltage	18...30 V DC
Current Consumption (Ub = 24 V)	< 80 mA
Measuring Rate	1500 /s
Measuring Rate (Resolution-Mode)	600 /s
Response Time	< 660 µs
Response Time (Resolution Mode)	< 1660 µs
Temperature Drift	< 15 µm/K
Temperature Range	-25...50 °C
Analog Output	0...10 V
Load Current Voltage Output	< 1 mA
Current Output Load Resistance	< 500 Ohm
Interface	RS-232
Transmission rate	38400 Bd
Protection Class	III
FDA Accession Number	0820588-000
Mechanical Data	
Setting Method	Teach-In
Housing Material	Plastic, ABS
Housing Material	Plastic, PC
Optic Cover	Plastic, PMMA
Degree of Protection	IP67
Connection	M12 × 1; 8-pin
Safety-relevant Data	
MTTFd (EN ISO 13849-1)	713,97 a
Error Output	●
Analog Output	●
RS-232 Interface	●
Connection Diagram No.	529
Control Panel No.	P7
Suitable Connection Equipment No.	80
Suitable Mounting Technology No.	380

Complementary Products


Analog Evaluation Unit AW02
Fieldbus Gateway ZAGxxxN01, EPGG001
Interface Cable S232W3
Protective Housing ZSV-0x-01
Set Protective Housing ZSP-NN-02
Software

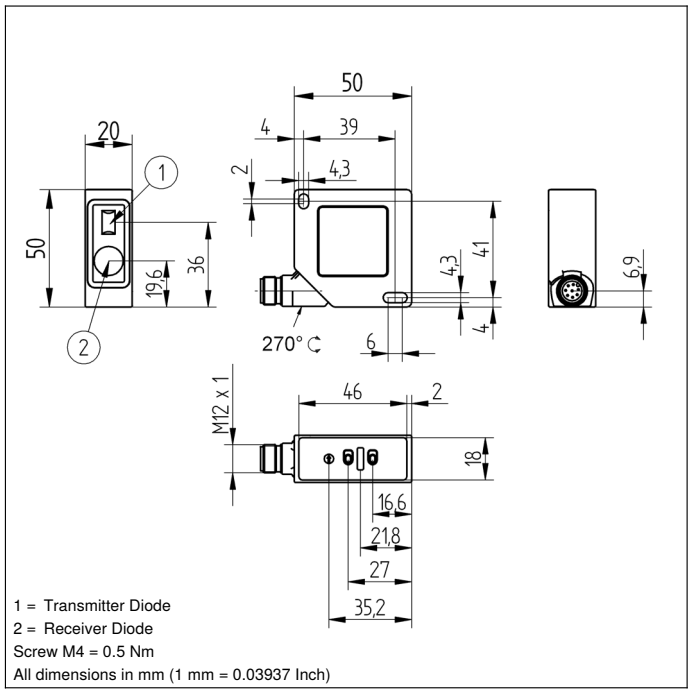


1 = Transmitter Diode
2 = Receiver Diode
Screw M4 = 0.5 Nm
All dimensions in mm (1 mm = 0.03937 Inch)

Ctrl. Panel

P7



03 = Error Indicator
07 = Selector Switch
12 = Analog Output Indicator
24 = Plus Button
25 = Minus Button
63 = Analog Output Current Indicator

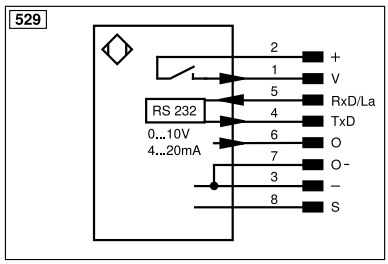


Legend					
+	Supply Voltage +	nc	Not connected	ENBRS422	Encoder B/B̄ (TTL)
–	Supply Voltage 0 V	U	Test Input	ENA	Encoder A
~	Supply Voltage (AC Voltage)	Ū	Test Input inverted	ENB	Encoder B
A	Switching Output (NO)	W	Trigger Input	AMIN	Digital output MIN
Ā	Switching Output (NC)	W–	Ground for the Trigger Input	AMAX	Digital output MAX
V	Contamination/Error Output (NO)	O	Analog Output	AOK	Digital output OK
V̄	Contamination/Error Output (NC)	O–	Ground for the Analog Output	SY In	Synchronization In
E	Input (analog or digital)	BZ	Block Discharge	SY OUT	Synchronization OUT
T	Teach Input	AMV	Valve Output	OLT	Brightness output
Z	Time Delay (activation)	a	Valve Control Output +	M	Maintenance
S	Shielding	b	Valve Control Output 0 V	rsv	Reserved
RxD	Interface Receive Path	SY	Synchronization	Wire Colors according to DIN IEC 60757	
TxD	Interface Send Path	SY–	Ground for the Synchronization	BK	Black
RDY	Ready	E+	Receiver-Line	BN	Brown
GND	Ground	S+	Emitter-Line	RD	Red
CL	Clock	⏚	Grounding	OG	Orange
E/A	Output/Input programmable	SnR	Switching Distance Reduction	YE	Yellow
	IO-Link	Rx+/–	Ethernet Receive Path	GN	Green
PoE	ower over Ethernet	Tx+/–	Ethernet Send Path	BU	Blue
IN	Safety Input	Bus	Interfaces-Bus A(+)/B(–)	VT	Violet
OSSD	Safety Output	La	Emitted Light disengageable	GY	Grey
Signal	Signal Output	Mag	Magnet activation	WH	White
BI_D+/–	Ethernet Gigabit bidirect. data line (A-D)	RES	Input confirmation	PK	Pink
EN0 RS422	Encoder 0-pulse 0/0̄ (TTL)	EDM	Contactor Monitoring	GNYE	Green/Yellow
PT	Platinum measuring resistor	ENARS422	Encoder A/Ā (TTL)		

Table 1

Working Distance	30 mm	80 mm
Spot Size	0,5 × 1 mm	1 × 2 mm

Output Graph

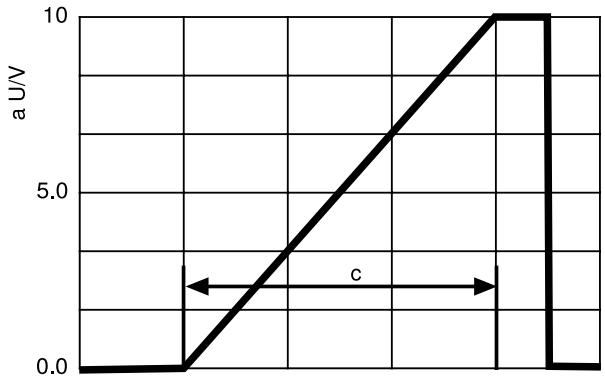

c = Measuring Range
a = Analog Voltage Output

Specifications are subject to change without notice V2-06.05.2025