

# FXTT0xx

Temperature Sensor with IO-Link



## Operating Instructions

Original operating instructions  
Subject to change without notice  
Available as PDF version only  
Version: 1.4.0  
Status: 11.05.2017  
[www.wenglor.com](http://www.wenglor.com)

# Table of Contents

- 1. General ..... 4**
  - 1.1 Information Concerning these Instructions ..... 4
  - 1.2 Explanations of Symbols ..... 4
  - 1.3 Limitation of Liability..... 5
  - 1.4 Copyrights ..... 5
- 2. For Your Safety ..... 6**
  - 2.1 Use for Intended Purpose ..... 6
  - 2.2 Use for Other than the Intended Purpose ..... 7
  - 2.3 Personnel Qualifications ..... 7
  - 2.4 Modification of Products ..... 7
  - 2.5 General Safety Precautions ..... 8
  - 2.6 Approvals and IP Protection ..... 8
- 3. Technical Data..... 9**
  - 3.1 Permissible Flow Rate..... 11
  - 3.2 Housing Dimensions ..... 12
  - 3.3 Wiring Diagram ..... 13
  - 3.4 Accessory Products ..... 13
  - 3.5 Layout..... 14
  - 3.6 Scope of Delivery ..... 14
- 4. Transport and Storage..... 14**
  - 4.1 Transport ..... 14
  - 4.2 Storage..... 14
- 5. Installation and Electrical Connection..... 15**
  - 5.1 System Overview..... 15
  - 5.2 Installation ..... 16
  - 5.3 Electrical Connection ..... 16
  - 5.4 Diagnostics..... 17

<b>6. Functions Overview .....</b>	<b>18</b>
6.1 Default Settings .....	18
6.2 Function Definitions.....	18
6.2.1 Hysteresis .....	19
6.2.2 Window Width .....	19
6.2.3 Analog .....	20
6.2.4 Remote Output .....	20
6.2.5 Filter .....	22
<b>7. Settings .....</b>	<b>23</b>
<b>8. IO-Link .....</b>	<b>24</b>
<b>9. Maintenance Instructions .....</b>	<b>24</b>
<b>10. Returns .....</b>	<b>24</b>
<b>11. Proper Disposal .....</b>	<b>24</b>
<b>12. Appendix .....</b>	<b>25</b>
12.1 Change Index, Operating Instructions.....	25
12.2 EU Declaration of Conformity .....	25

# 1. General

## 1.1 Information Concerning these Instructions

- These instructions apply to the product with ID code FXFF0xx.
- They make it possible to use the product safely and efficiently.
- These instructions are an integral part of the product and must be kept on hand for the entire duration of its service life.
- Local accident prevention regulations and national work safety regulations must be complied with as well.
- The product is subject to further technical development, and thus the information contained in these operating instructions may also be subject to change. The current version can be found at [www.wenglor.com](http://www.wenglor.com) in the product's separate download area.



**NOTE!**

The operating instructions must be read carefully before using the product and must be kept on hand for later reference!

## 1.2 Explanations of Symbols

- Safety precautions and warnings are emphasized by means of symbols and attention-getting words.
- Safe use of the product is only possible if these safety precautions and warnings are adhered to.
- The safety precautions and warnings are laid out in accordance with the following principle:



**Attention-Getting Word  
Type and Source of Danger!**

Possible consequences in the event that the hazard is disregarded.

- Measures for averting the hazard.

The meanings of the attention-getting words, as well as the scope of the associated hazards, are listed below.



**DANGER!**

This word indicates a hazard with a high degree of risk which, if not avoided, results in death or severe injury.



**WARNING!**

This word indicates a hazard with a medium degree of risk which, if not avoided, may result in death or severe injury.



**CAUTION!**

This word indicates a hazard with a low degree of risk which, if not avoided, may result in minor or moderate injury.

**ATTENTION!**

This word draws attention to a potentially hazardous situation which, if not avoided, may result in property damage.

**NOTE!**

A note draws attention to useful tips and suggestions, as well as information regarding efficient, error-free use.

### 1.3 Limitation of Liability

- The product has been developed in consideration of the current state-of-the-art and applicable standards and guidelines. Subject to change without notice. A valid declaration of conformity can be accessed at [www.wenglor.com](http://www.wenglor.com) in the product's separate download area.
- wenglor sensoric elektronische Geräte GmbH (hereinafter referred to as "wenglor") excludes all liability in the event of:
  - Non-compliance with the instructions
  - Use of the product for purposes other than those intended
  - Use by untrained personnel
  - Use of unapproved replacement parts
  - Unapproved modification of products
- These operating instructions do not include any guarantees from wenglor with regard to the described procedures or specific product characteristics.
- wenglor assumes no liability for printing errors or other inaccuracies contained in these operating instructions, unless wenglor was verifiably aware of such errors at the point in time at which the operating instructions were prepared.

### 1.4 Copyrights

- The contents of these instructions are protected by copyright law.
- All rights are reserved by wenglor.
- Commercial reproduction or any other commercial use of the provided content and information, in particular graphics and images, is not permitted without previous written consent from wenglor.

## 2. For Your Safety

### 2.1 Use for Intended Purpose

The product is based on the following functional principle:

#### Temperature Sensor

The Temperature Sensor measures the temperature of liquid and gaseous media, and makes it possible to monitor temperature within processes.

There's a sensor in the measuring probe of the wenglor Temperature Sensor which detects temperature changes and converts them into electrical signals. The sensor's parameters can be configured via IO-Link and adapted to the respective application. Either two switching outputs, one switching output and one analog output (4 to 20 mA/ 0 to 10 V) or one 2-wire analog output (4 to 20 mA) is available depending on settings and connection configuration.

This product can be used in the following industry sectors:

- Special machinery manufacturing
- Heavy machinery manufacturing
- Logistics
- Automotive industry
- Food industry
- Packaging industry
- Pharmaceuticals industry
- Clothing industry
- Plastics industry
- Woodworking industry
- Consumer goods industry
- Paper industry
- Electronics industry
- Glass industry
- Steel industry
- Printing industry
- Construction industry
- Chemicals industry
- Agriculture industry
- Alternative energy
- Raw materials extraction

## 2.2 Use for Other than the Intended Purpose

- Not a safety component in accordance with 2006/42/EC (Machinery Directive)
- The product is not suitable for use in potentially explosive atmospheres.
- The product may only be used with accessories supplied or approved by wenglor, or in combination with approved products. A list of approved accessories and combination products can be accessed at [www.wenglor.com](http://www.wenglor.com) on the product detail page.



---

### **DANGER!**

#### **Risk of personal injury or property damage in case of use for other than the intended purpose!**

Use for other than the intended purpose may lead to hazardous situations.

- Instructions regarding use for intended purpose must be observed.
- 

## 2.3 Personnel Qualifications

- Suitable technical training is a prerequisite.
- In-house electronics training is required.
- Trained personnel must have uninterrupted access to the operating instructions.



---

### **DANGER!**

#### **Risk of personal injury or property damage in case of incorrect initial start-up and maintenance!**

Personal injury and damage to equipment may occur.

- Adequate training and qualification of personnel.
- 

## 2.4 Modification of Products



---

### **DANGER!**

#### **Risk of personal injury or property damage if the product is modified!**

Personal injury and damage to equipment may occur. Non-observance may result in loss of the CE marking and the guarantee may be rendered null and void.

- Modification of the product is impermissible.
-

## 2.5 General Safety Precautions

### NOTE!

- These instructions are an integral part of the product and must be kept on hand for the entire duration of its service life.
- In the event of possible changes, the respectively current version of the operating instructions can be accessed at [www.wenglor.com](http://www.wenglor.com) in the product's separate download area.
- Read the operating instructions carefully before using the product.
- Protect the sensor against contamination and mechanical influences.
- Installation and removal of the product are only permissible in pressure-free piping systems which have been allowed to cool down.



## 2.6 Approvals and IP Protection



**RoHS**






### 3. Technical Data

Order Number	
Technical Data	FXTT0xx
<b>Sensor-Specific Data</b>	
Measuring range	–50...150° C
Setting range	–50...150° C
Medium	Liquids, gases
Measuring error	± 0.5° C
Step response time T90	< 2 s
Resolution	0.01° C
<b>Ambient Conditions</b>	
Ambient temperature	–25...80° C
Media temperature	–50...150° C
Storage and transport temperature	–40...100° C
Relative humidity	100%
EMC	DIN EN 61326-2-3
Shock resistance	50 g/11 ms
Vibration resistance	20 g (10...2000 Hz)
<b>Electrical Data</b>	
Supply power	
2-wire	12...32 V DC
3-wire	12...32 V DC
IO-Link	18...30 V DC
Current consumption (U <sub>0</sub> = 24 V)	≤ 25 mA
Short-circuit proof	Yes
Reverse polarity and overload-proof	Yes
<b>Analog output</b>	
Output load resistance	$4...20 \text{ mA} / 0...10 \text{ V}$ $< \frac{(U_b - U_{min})}{20 \text{ mA}} > 1 \text{ kOhm}$
<b>Switching output</b>	
Voltage drop	< 1.5 V
Switching current	≤ 100 mA
Residual current	< 250 µA
Switchable to NC or NO	Yes
Interface	IO-Link
IO-Link version	1.1
Protection class	III
Operating delay time	< 300 ms
<b>Mechanical Data</b>	
Setting method	IO-Link
Housing material	Stainless steel 1.4404
Media contacting materials	Stainless steel 1.4404

Protection	IP68, IP69K
Connector type	M12 × 1, 4-pin
Process connection	See data sheet
Process connection length PCL	See data sheet
Probe Length PL	See data sheet
Rod diameter	6 mm
<b>Output Function</b>	
Switching output	2 each
Analog output	2-wire
	3-wire
Configurable as PNP, NPN or push-pull	Yes
Switchable to NC or NO	Yes

The following table specifies the tightening torques of the plugs and mounting options in order to assure compliant, error-free operation:

Connector Type	Tightening Torque (Nm)
M12	0,4



**CAUTION!**

- Pressure resistance specified in the data sheet always makes reference to the sensor rod.
- Amongst other factors, the system’s pressure resistance is also dependent on the utilized mounting components (adapters), and is only as high as the pressure resistance of the weakest component.

### 3.1 Permissible Flow Rate

Maximum permissible flow rate depending on the temperature of the medium, pressure and probe length:

Pressure	Probe Length					Medium Temperature
	10 mm	50 mm	100 mm	150 mm	200 mm	
PN25 (25 bar)	400 cm/s	400 cm/s	400 cm/s	400 cm/s	400 cm/s	20° C
						60° C
						100° C
						150° C
PN40 (40 bar)	400 cm/s	400 cm/s	400 cm/s	400 cm/s	400 cm/s	20° C
						60° C
						100° C
					350 cm/s	150° C
PN64 (64 bar)	400 cm/s	400 cm/s	400 cm/s	400 cm/s	200 cm/s	20° C
					150 cm/s	60° C
						100° C
						150° C
PN100 (100 bar)	400 cm/s	400 cm/s	400 cm/s	400 cm/s	Not permissible	20° C
				350 cm/s		60° C
				300 cm/s		100° C
						150° C

### 3.2 Housing Dimensions

See the product selector for other process connections (<https://www.wenglor.com/index.php?id=966&L=1>). Overall housing dimensions are included in the respective data sheet.

Cutting/Locking Ring	M18 × 1 Sealing Cone

Process connection length PCL in the case of a cutting/locking ring = probe length PL + 9 mm  
Process connection length PCL in the case of an M18×1 sealing cone = probe length PL + 32 mm

**NOTE!**




- There's a marking on the sensor's sleeve (see figure).
- This is a reference point (starting point) relative to the length of the process connection (see data sheet or instructions), and provides assistance in correctly positioning the sensor within the piping system.




3.3 Wiring Diagram

139



142



Legend

+	Supply Voltage +
-	Supply Voltage 0 V
~	Supply Voltage (AC Voltage)
A	Switching Output (NO)
Å	Switching Output (NC)
V	Contamination/Error Output (NO)
∇	Contamination/Error Output (NC)
E	Input (analog or digital)
T	Teach Input
Z	Time Delay (activation)
S	Shielding
RxD	Interface Receive Path
TxD	Interface Send Path
RDY	Ready
GND	Ground
CL	Clock
E/A	Output/Input programmable
IO-Link	IO-Link
PoE	Power over Ethernet
IN	Safety Input
OSD	Safety Output
Signal	Signal Output
BI-D+/-	Ethernet Gigabit bidirect. data line (A-D)
EN0/EN422	Encoder 0-pulse 0-0̇ (TTL)

PT	Platinum measuring resistor
nc	not connected
U	Test Input
Ū	Test Input inverted
W	Trigger Input
O	Analog Output
O-	Ground for the Analog Output
BZ	Block Discharge
AWV	Valve Output
a	Valve Control Output +
b	Valve Control Output 0 V
SY	Synchronization
E+	Receiver-Line
S+	Emitter-Line
±	Grounding
SnR	Switching Distance Reduction
Rx+/-	Ethernet Receive Path
Tx+/-	Ethernet Send Path
Ba	Interfaces-Bus A(+)/B(-)
La	Emitted Light disengageable
Mag	Magnet activation
RES	Input confirmation
EDM	Contactur Monitoring
EN0/EN422	Encoder A/Å (TTL)
EN0/EN422	Encoder B/Ḃ (TTL)

ENa	Encoder A
ENb	Encoder B
AMIN	Digital output MIN
AMAX	Digital output MAX
ACK	Digital output OK
SY in	Synchronization In
SY OUT	Synchronization OUT
0LT	Brightness output
M	Maintenance

Wire Colors according to DIN IEC 757


BK	Black
BN	Brown
RD	Red
OG	Orange
YE	Yellow
GN	Green
BU	Blue
VT	Violet
GY	Grey
WH	White
PK	Pink
GNYE	Green/Yellow

3.4 Accessory Products

wenglor can provide you with suitable connection technology for your product.

Suitable mounting technology no.	Cutting/locking ring: 907 908
	M18 × 1 sealing cone: 900 901
Suitable connection technology no.	2
	502
IO-Link master	ZAI72AN01 EFBL001 EFBL002

### 3.5 Layout

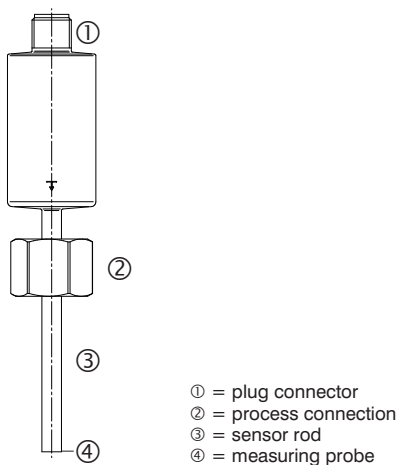

### 3.6 Scope of Delivery

- FXTTxxx Temperature Sensor
- Quick-start guide

## 4. Transport and Storage

### 4.1 Transport

Upon receipt of shipment, inspect the goods for damage in transit. In the case of damage, conditionally accept the package and notify the manufacturer of the damage. Then return the device, making reference to damage in transit.

### 4.2 Storage

The following points must be taken into condition with regard to storage:

- Do not store the product outdoors.
- Store the product in a dry, dust-free place.
- Protect the product against mechanical impacts.



#### **ATTENTION!**

#### **Risk of property damage in case of improper storage!**

The product may be damaged.

- Comply with storage instructions.

## 5. Installation and Electrical Connection

### 5.1 System Overview



#### Connector Cables

ZCCL001 (straight, PVC, IP69K) 10 m

S23-2M (straight, PVC) 2 m

S23-2MPUR (straight, PUR) 2 m

S23-5M (straight, PVC) 5 m

S23-5MPUR (straight, PUR) 5 m

S23-10M (straight, PVC) 10 m

S23-10MPUR (straight, PUR) 10 m

S29-2M (angled, PVC) 2 m

S29-5M (angled, PVC) 5 m

S29-5MPUR (angled, PUR) 5 m

S29-10M (angled, PVC) 10 m

#### Accessory Products

IO-Link Master EFBL001/EFBL002, ZAI72AN01

#### Adapters

... for cutting/locking ring

Cutting ring fitting: ZH6C001, ZH6C002

Locking ring fitting: ZH6C003, ZH6C004

Sealing ring: ZH5G001, ZH5G002

...for sealing cone M18×1

G 1/4": ZH1C001, ZH1C008

G 1/2": ZH1C002, ZH1C003, ZH1C007

NPT: ZH1C004, ZH1C005

Welding fitting: ZH4C004, ZH4C005

## 5.2 Installation

- Protect the product from contamination during installation.
- Observe all applicable electrical and mechanical regulations, standards, and safety rules.
- Protect the product against mechanical influences.
- Make sure that the sensor is mounted in a mechanically secure fashion.
- Specified torque values must be complied with (see „3. Technical Data“ on page 9).



### **ATTENTION!**

#### **Risk of property damage in case of improper installation!**

The product may be damaged.

- Comply with installation instructions.
- 



### **CAUTION!**

#### **Risk of personal injury or property damage during installation!**

Personal injury and damage to the product may occur.

- Ensure a safe installation environment.
- 

## 5.3 Electrical Connection

- Connect the sensor to 12 to 32 V DC (see „3.2 Wiring Diagram“ on page 13).
- When operated with IO-Link:
  - An IO-Link master with class A port must be used because pin 5 is not connected in the case of a class A port.
  - In the case of excessive interference, a shielded cable should be used.



### **DANGER!**

#### **Risk of personal injury or property damage due to electric current!**

Voltage conducting parts may cause personal injury or damage to equipment.

- The electric device may only be connected by appropriately qualified personnel.
-



## 5.4 Diagnostics

Required action in case of fault:



### NOTE!

- Shut down the machine.
- If the error cannot be eliminated, please contact wenglor's support department.
- Do not operate in case of indeterminate malfunctioning.
- The machine must be shut down if the error cannot be unequivocally clarified or reliably eliminated.



---

### DANGER!

#### **Risk of personal injury or property damage in case of non-compliance!**

The system's safety function is disabled. Personal injury and damage to equipment.

- Required action as specified in case of fault.
-

## 6. Functions Overview

### 6.1 Default Settings

		FXTT001...004
Function A1	Output	Switching output
	Measurement, physical quantity	Temperature
	Output function	PNP NO
	Switching point 1	75° C
	Switching point 2	50° C
Function A2	Output	Analog output
	Measurement, physical quantity	Temperature
	Output function	Current: 4 ... 20 mA
	Initial value, analog output	-50° C
	Final value, analog output	150° C


### 6.2 Function Definitions

- All functions are configured via the IO-Link interface.
- Refer to the interface protocol concerning parameters configuration (available at [www.wenglor.com](http://www.wenglor.com) on the product detail page).

Designation	Function	Page
Hysteresis	Adjust switching hysteresis	Page 19
Window width	Set window width	Page 19
Analog	Scale analog output	Page 20
Remote output	Output for external control signals	Page 20
Filter	Set the filter	Page 22


### 6.2.1 Hysteresis

- Depending on the settings selected for switching points 1 and 2, the sensor's switching performance can be adjusted to the application.

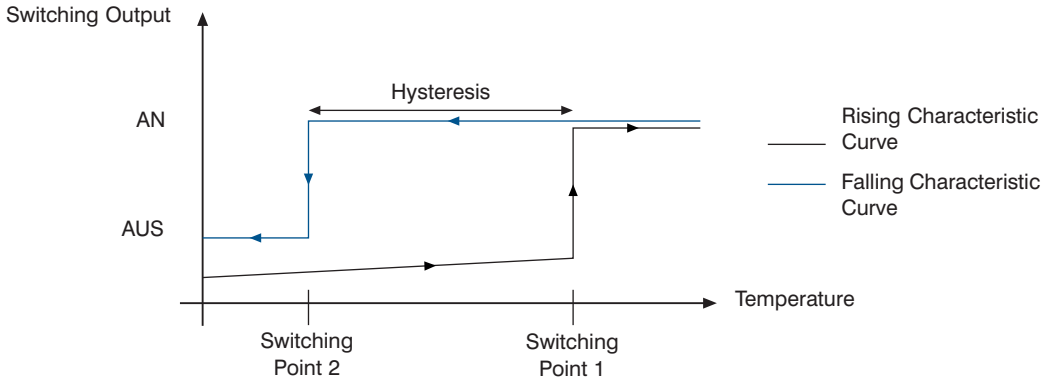

### 6.2.2 Window Width


- If switching points 1 and 2 are reversed, a window for actual and target value comparison can be set up with just one switching output.
- Refer to the interface protocol concerning parameters configuration (available at [www.wenglor.com](http://www.wenglor.com) on the product detail page).

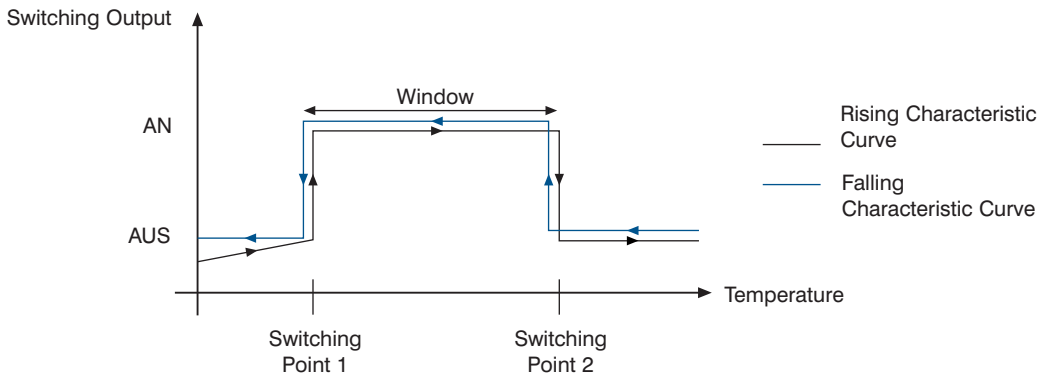

Hysteresis amounts to 0.5° C for temperature.

### 6.2.3 Analog

- Allocation of the analog starting point of 4 mA/0 V and the analog end point of 20 mA/10 V to the measuring range is freely selectable.

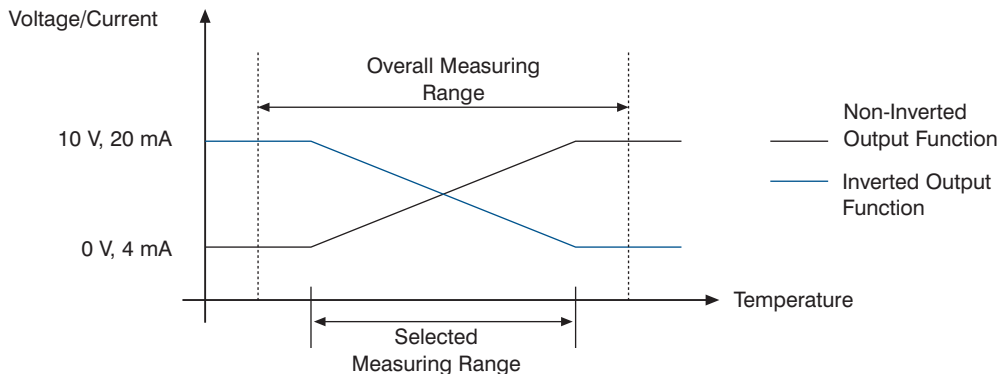

### 6.2.4 Remote Output

#### General Explanation

- If the sensor is operated with IO-Link (pin 4), the free output (pin 2) can be used for control signals.
- The output can be configured as a switching output or as an analog output.
- In this way, the need for an additional output at the controller is eliminated and external components can be switched by the sensor (e.g. a lamp) or actuated by means of an analog control signal (U/I) (e.g. a valve).

#### Prerequisite

- The sensor must be operated via IO-Link.

#### Procedure

- See figures 1 and 2 below with regard to wiring and connection.
- Setup via IO-Link in order to specify whether pin 2 is a remote analog output (U/I) or a remote switching output.
- The controller transmits the signal intended for the external component via IO-Link.
- The sensor transmits the signal to pin 2 (analog or switching output) and forwards it.
- The external component is controlled by the sensor's output. No additional output is required at the controller.
- The analog output can be scaled from 0 ... 1000 (0 = 4 mA / 0 V, 1000 = 20 mA / 10 V).

## Wiring

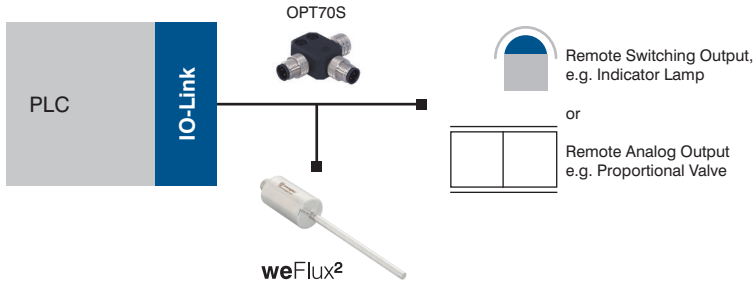


Figure 1: Wiring With Remote Output Function

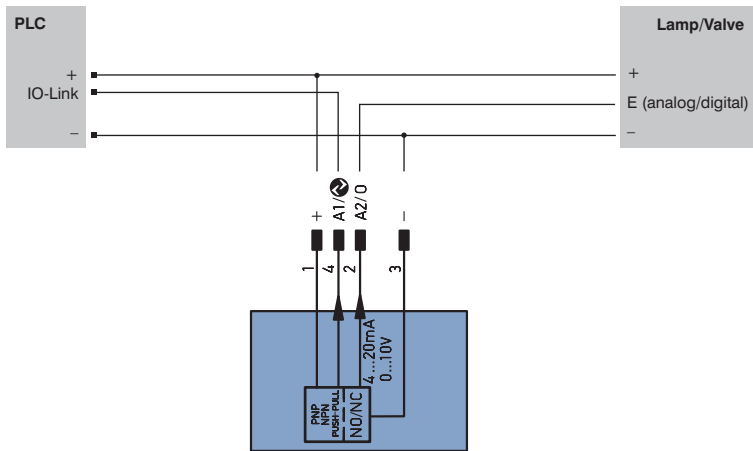


Figure 2: Wiring

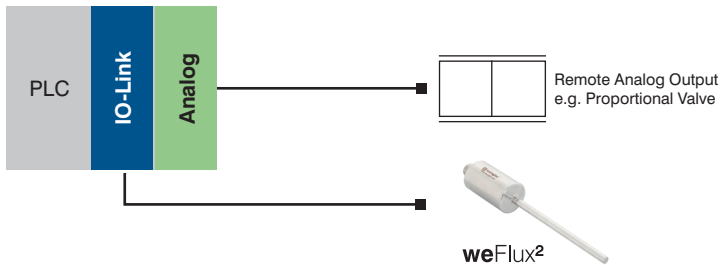


Figure 3: Wiring Without Remote Output Function

### 6.2.5 Filter

- The filter represents the number of values used by the sensor to generate a mean value.
- The higher the filter number, the longer the sensor's step response time T90 when the measured values change.

Filter	Number of Measured Values	Step Response Time T90
0	1	Approx. 1.2 s
1	2	Approx. 1.3 s
2	4	Approx. 1.4 s
3	8	Approx. 1.5 s
4 (default)	16	Approx. 1.8 s
5	32	Approx. 2.4 s
6	64	Approx. 3.6 s
7	128	Approx. 5.9 s
8	256	Approx. 11 s
9	512	Approx. 20 s
10	1024	Approx. 39 s

## 7. Settings

Parameters adjustable via the IO-Link interface:

<b>Sensor Settings</b>	
Temperature unit of measure	°C °F
Switching output function	PNP NPN Push-pull
Function, output 2	Switching output Analog output Remote switching output Remote analog output
Filter	0 ... 10 where 0 = filter off
<b>Output Settings</b>	
<b>Output 1 (switching output)</b>	
Switching point 1	−50...150° C
Switching point 2	−50 ... 150° C
Switching function	NO NC
<b>Output 2 (switching output)</b> – only visible if switching output has been selected for “Function, output 2” –	
Switching point 1	−50...150° C
Switching point 2	−50...150° C
Switching function	NO NC
<b>Output 2 (analog output)</b> – only visible is analog output has been selected for “Function, output 2” –	
Starting temperature (value for 4 mA / 0 V)	−50...150° C
End temperature (value for 20 mA / 10 V)	−50...150° C
Analog output	Current: 4...20 mA Voltage 0...10 V
<b>Output 2 (remote switching output)</b> – only visible if remote switching output has been selected for “Function, output 2” –	
Output	Open/closed
<b>Output 2 (remote analog output)</b> – only visible if remote analog output has been selected for “Function, output 2” –	
Analog value	0 to 1000
<b>Sensor Restrictions</b>	
Write access disabling	Yes No
Data storage disabling	Yes No
<b>Sensor Commands</b>	
Standard	Restore default settings

#### **Process data available via IO-Link interface:**

- Status of the switching outputs
- Media temperature

## **8. IO-Link**

Process and parameters data can be found at [www.wenglor.com](http://www.wenglor.com) in the product's separate download area.

## **9. Maintenance Instructions**

### **NOTE!**



- This wenglor sensor is maintenance-free.
- Cleaning and inspection of the plug connections at regular intervals is advisable.
- Do not clean the sensor with solvents or cleansers which could damage the product.
- The product must be protected against contamination during initial start-up.
- Contamination which adheres to the measuring probe distorts the measured value for flow rate.

## **10. Returns**

Due to legal regulations and for the protection of employees, wenglor sensoric GmbH requires a signed declaration of decontamination before your order can be processed.

The corresponding form is available at [www.wenglor.com](http://www.wenglor.com) → Download → General Terms and Conditions and Returns.

## **11. Proper Disposal**

wenglor sensoric GmbH does not accept the return of unusable or irreparable products. Respectively valid national waste disposal regulations apply to product disposal.



## 12. Appendix

### 12.1 Change Index, Operating Instructions

Version	Date	Description/Change
1.0.0	08.06.2016	Initial version of the operating instructions
1.1.0	27.10.2016	Expansion of the connection cables and adaptation of supplementary products in the system overview
1.2.0	28.11.2016	Adaptation of sensor specific data
1.3.0	16.01.2017	Adaptation of supply voltage in the 2-wire operating mode
1.4.0	11.05.2017	Expansion of the section entitled "Permissible Flow Rate"

### 12.2 EU Declaration of Conformity

The EU declaration of conformity can be found on our website at [www.wenglor.com](http://www.wenglor.com) in the product's separate download area.